



DAV PUBLIC SCHOOL

UNIT - VIII, BHUBANESWAR, ODISHA

AFFILIATED TO CBSE, NEW DELHI, AFFILIATION No.1530006, SCHOOL No. 15342

Ref. No. DAV(UNIT-VIII)/ 1180 /2026

Date : 22-05-2026

QUOTATION CALL NOTICE

Sealed quotations are invited by the undersigned from the agency / supplier for supply & installation of Panel Board & Sub-Panel Board. Interested parties may furnish their rates as per the list given below through post / courier / by hand to the undersigned. The last date of receipt of quotation is **30-05-2026 by 04:00PM**. The quotation received either after the stipulated date & time or without the prescribed proforma or incomplete in any respect will not be considered. The quotation without GST / TIN / PAN number shall not be considered. The envelope containing the quotation must be super scribed as "**QUOTATION FOR PANEL BOARD & SUB-PANEL BOARD**". The undersigned reserves the right to cancel either any or all the quotations without assigning any reason thereof.

Encl: Form of Quotation along with the sample diagram.


22/05/26
PRINCIPAL

Copy to:

1. The Notice Board & Website of the school for information of all concerned.
2. The Principal, DAV Public Schools, Bhubaneswar & Cuttack with a request to kindly take necessary steps to display the notice on the School Notice Board for information for all concerned.
3. The concerned file for record.

DAV PUBLIC SCHOOL, UNIT-VIII, BHUBANESWAR-12

FORM OF QUOTATION FOR SUPPLY & INSTALLATION OF PANEL BOARD & SUB-PANEL BOARD

Quotation No. _____

Date. _____

Name of the Supplier.....

Complete Postal Address.....

E-Mail.....

Tel. Phone No.....

PAN No..... TIN No..... GST No.....

SL NO	SPECIFICATION	UNIT	RATE
1	Supply, Installation, Testing & Commissioning of Main Panel Wall mounted cubical type electrical panel (for both light & power circuit) made out by 16SWG CRCA steel sheet duly derusted & painted by simens grey powder coat paint is designed as GA drawing as per direction of Engineer-in-charge In comer- 01no 125A 4P MCCB 25kA, with ROM & S Link Busbar-04nos of 125Amps Electrolytic copper bus bar duly sleeved by colour coded PVC sleeve & supported by suitable size DMC insulator Outgoing- 02nos 63A 4P MCB 10kA, C series for 1no Lift & 1no Spare Outgoing- 04nos 40A 4P MCB 10kA, C series for AC BDB Outgoing- 04nos 32A 4P MCB 10kA, C series for Light BDB Outgoing- 03nos 32A DP MCB 10kA, C series Spare Instrument- (i) 03nos phase indicating lamp with toggle switch & HRC fuse (ii) 01set of 0-125Amps Ammeter Digital type & CTS (DIGITAL) (iii) 01set of 0-500voltmeter Digital type (Digital) Duly factory wired	Set	
2	Supply, installation, Testing & Commissioning of Out Door Type floor mounted cubical type Bus Bar Box (for connection of Existing Cable) made out by 04nos of 125Amp copper bus duly sleeved by colour coded PVC sleeve & supported by suitable size DMC insulator & provision for connection for cable with 16SWG CRCA steel sheet duly derusted & painted by simens grey powder cote paint is designed as G.A drawing as per direction of Engineer-in-charge	Set	
3	300mm length u type Copper bus bar made out of 25x25mm cu flat with provision of 14mm hole for connection of existing earthing terminal	Set	


N.B. 1. The aforesaid specification is subject to change, if need arises.

2. TDS will be deducted as per IT rules.


3. Any other term / conditions: _____

Signature of the
Proprietor with Official Seal & Date

MAIN PANEL

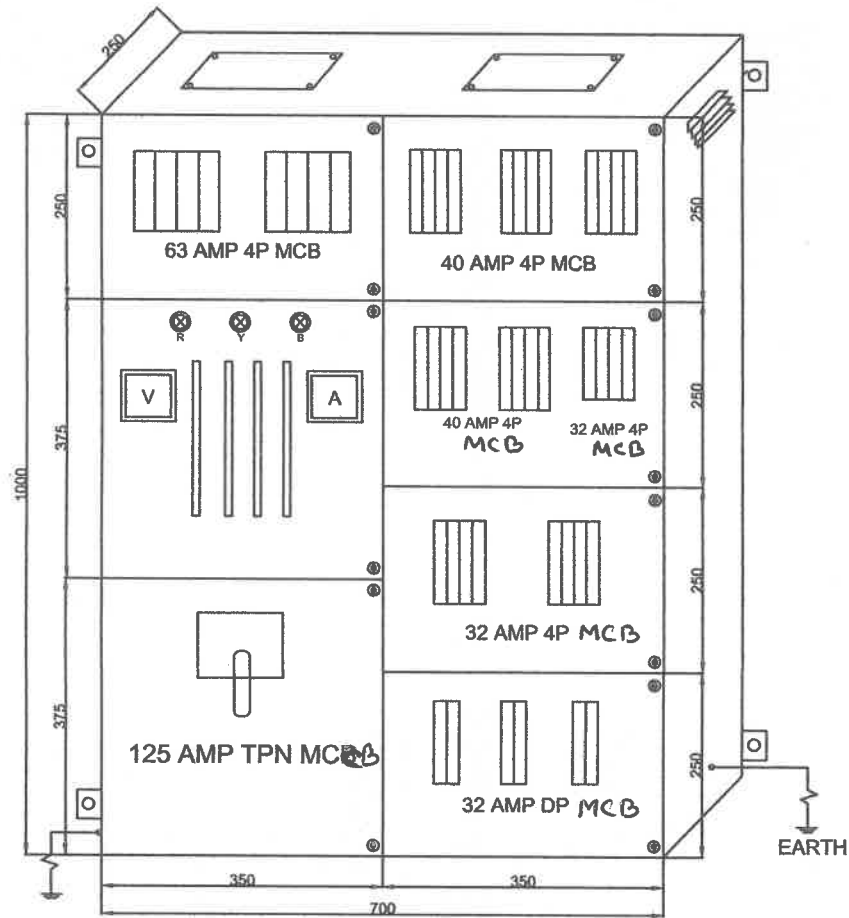


FRONT VIEW

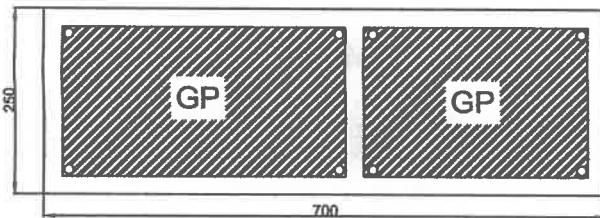



BOTTOM VIEW

OD TYPE BUS BAR BOX

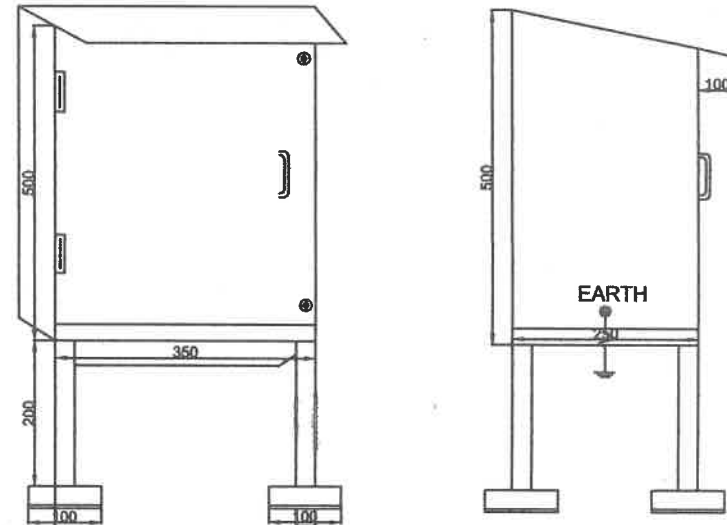

FRONT VIEW

SIDE VIEW

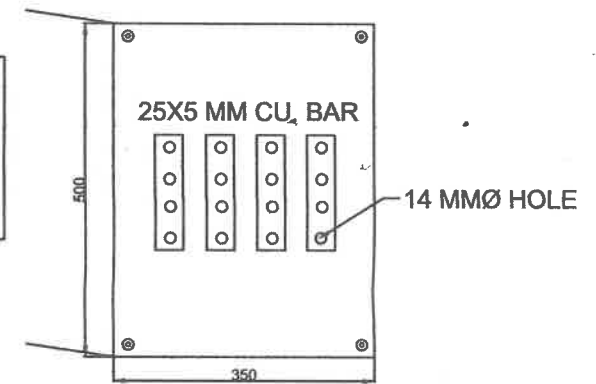

PANEL OPEN VIEW